



Utility Engineering Consultants, LLC

Phone : 205.951.3838
FAX : 205.951.3839
WEB : www.uecllc.com

130 Southcrest Drive, Suite 100
Homewood, AL 35209
P.O. Box 19218
Birmingham, Alabama 35219

May 10, 2021

**The Sewage Disposal Board of the
City of Red Bay
P O Box 2003
Red Bay, Alabama 35582**

**Re: PROPOSED CITY OF RED BAY TRUNK LINE UPGRADE PROJECT
PHASE 1 – CONTRACT 4
CWSRF PROJECT NO. CS010833-03**

All Contractors shall acknowledge receipt of Addendum No. 3 for above referenced job by signing and returning this statement by Email: jjones@uecllc.com or Fax to (205) 951-3839.

Contractor: _____

Received by: _____

Date: _____



Utility Engineering Consultants, LLC

Phone : 205.951.3838
FAX : 205.951.3839
WEB : www.uecllc.com

130 Southcrest Drive, Suite 100
Homewood, AL 35209
P.O. Box 19218
Birmingham, Alabama 35219

May 10, 2021

**The Sewage Disposal Board of the
City of Red Bay
P O Box 2003
Red Bay, Alabama 35582**

**Re: PROPOSED CITY OF RED BAY TRUNK LINE UPGRADE PROJECT
PHASE 1 – CONTRACT 4
CWSRF PROJECT NO. CS010833-03**

ADDENDUM NO. 3

The changes, modifications and/or additions covered by and set forth in this Addendum No. 3 shall become part of and be incorporated in the Specifications, Contract Documents and Bid Documents for the above referenced project.

DRAWINGS:


Sheet 6 of 8 – shall be reissued with the attached Sheet 6 of 8. Sheet 6 of 8 reflect tees at the connection points along the new and existing trunk lines. Saddles and inserta -tees are acceptable connection methods.

This Addendum No. 3 shall be made a part of your set of Construction Contract Documents and Specifications. Acknowledgment of receipt of Addendum No. 3 shall be noted in Section 00410 Bid Form in this Addendum.

UTILITY ENGINEERING CONSULTANTS, LLC

Roderick A. Hawkins

RAH/jj

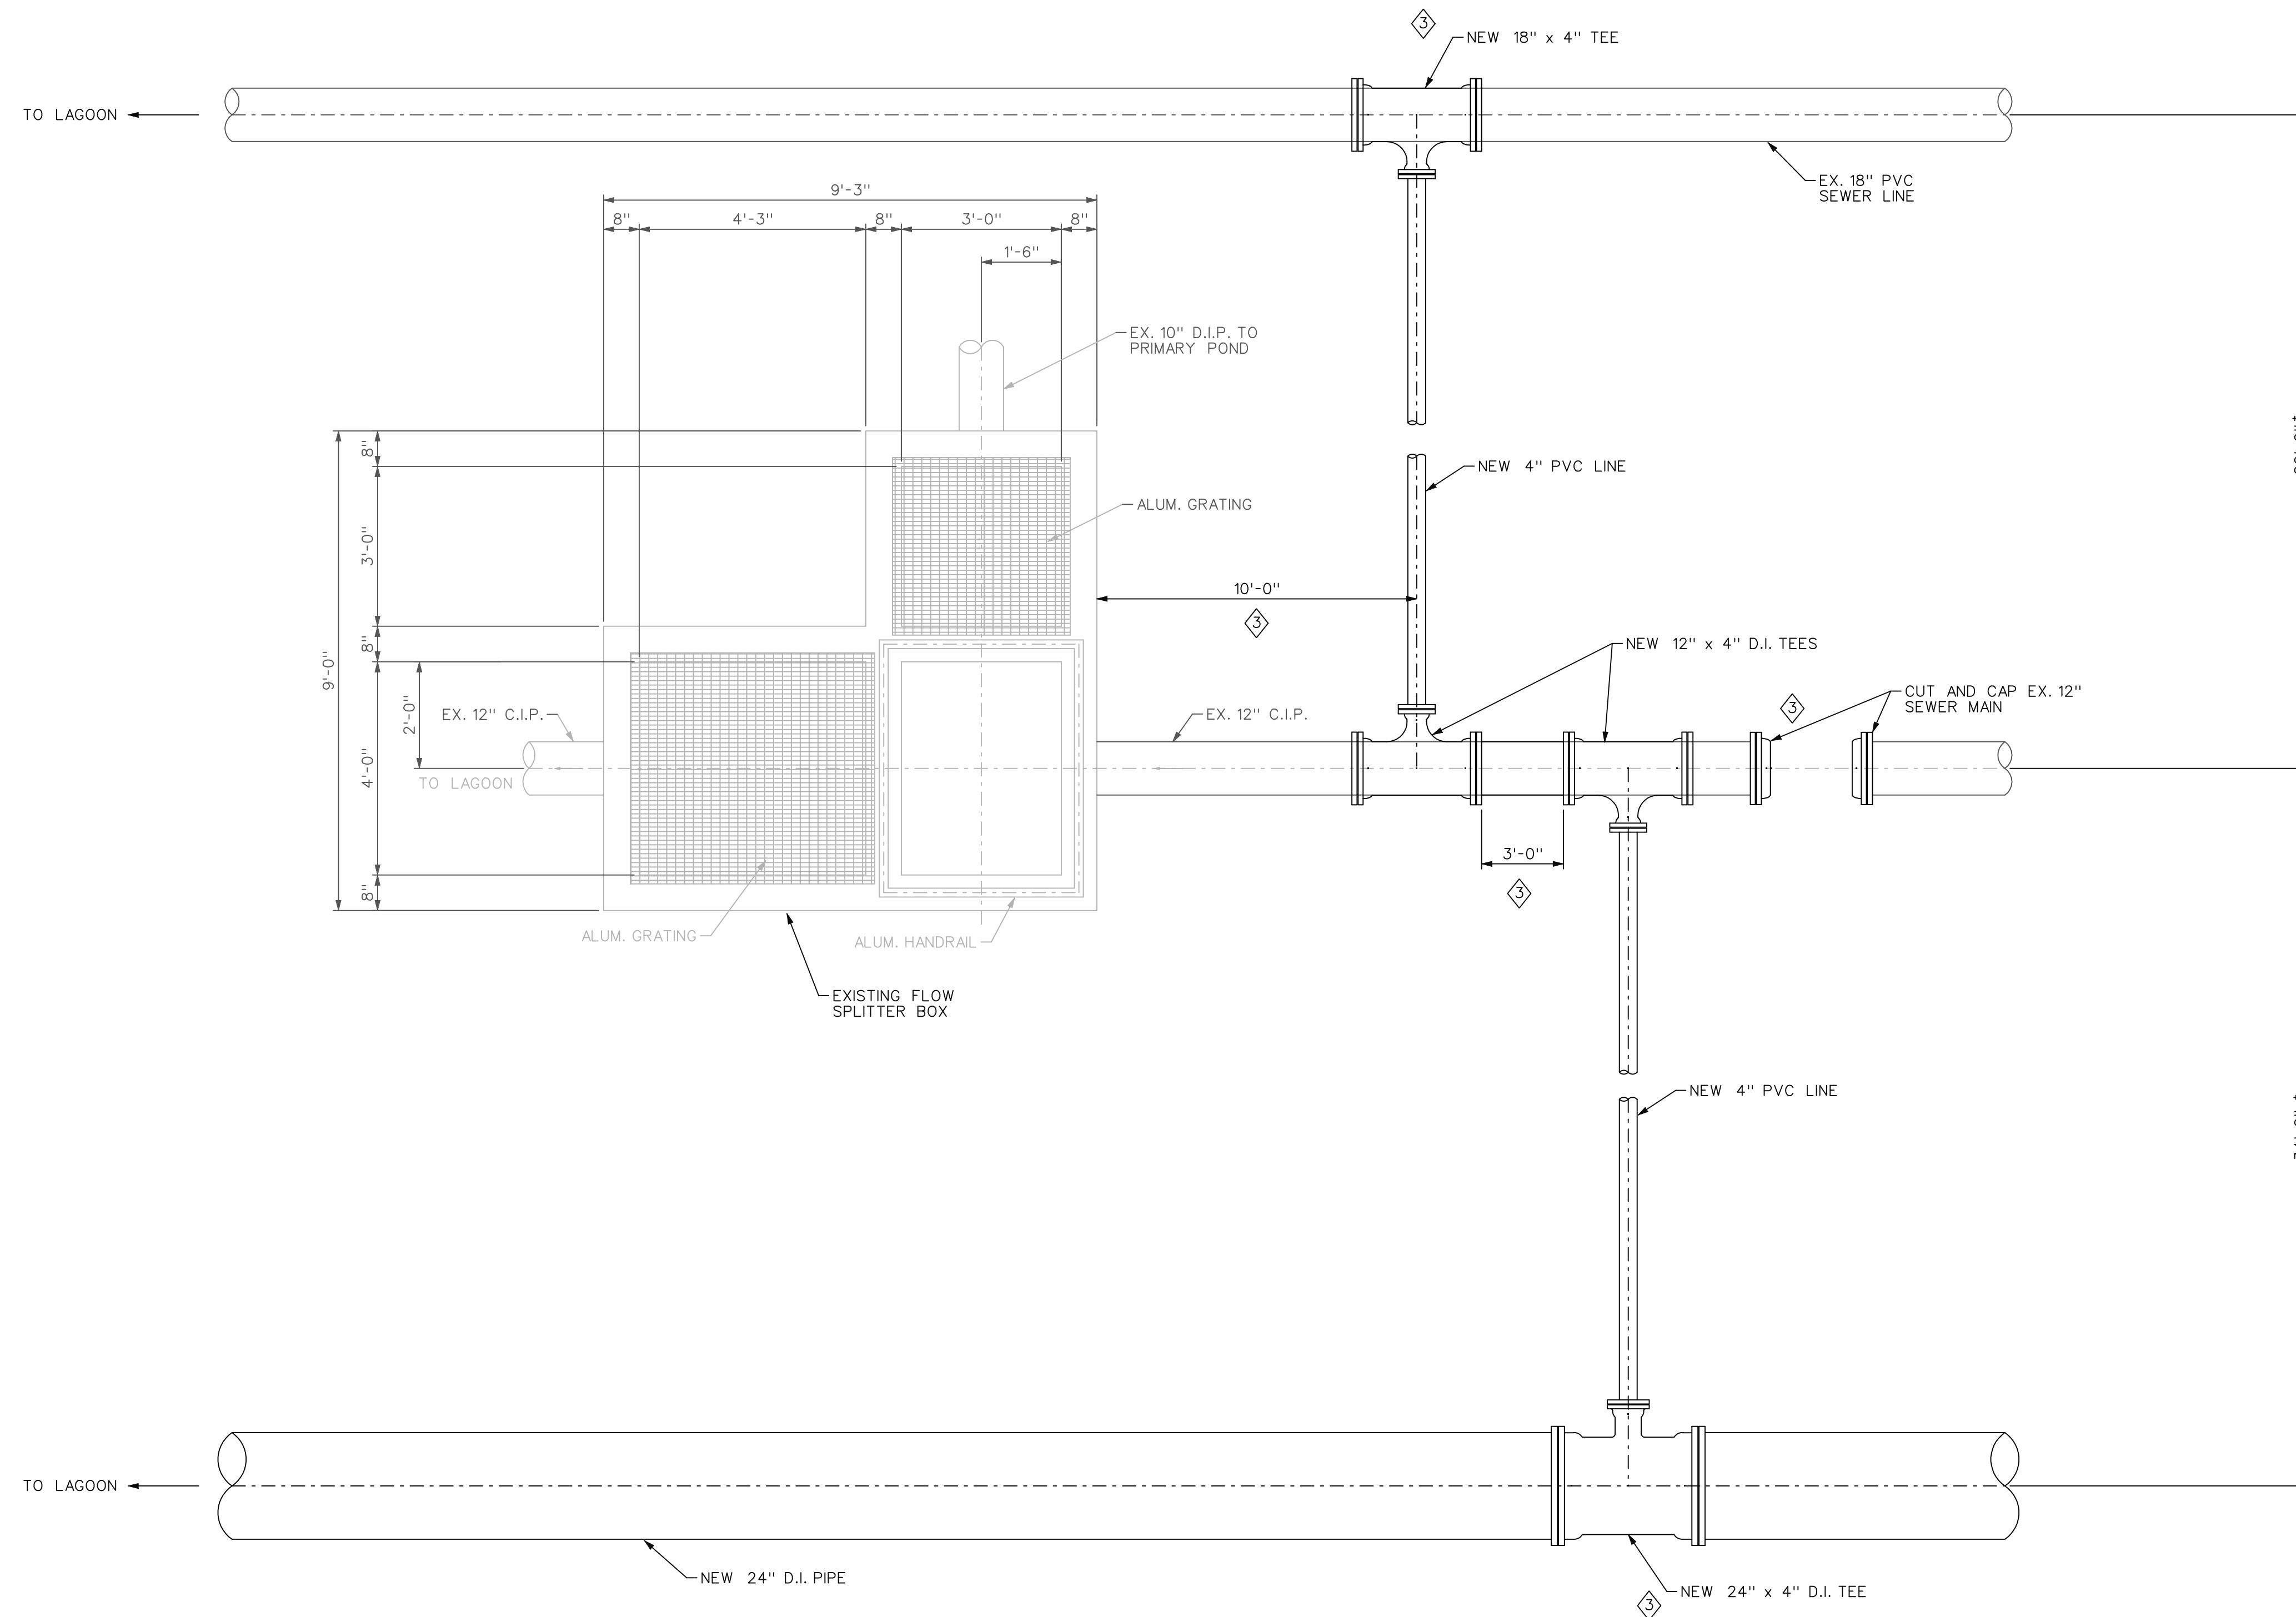

COMBINED INFLUENT SAMPLING STATION PLAN
 SCALE: 1/2" = 1'-0"



NO.	DATE	REMARKS	BY
	5/10/21	ADDENDUM 3	RAH
	4/14/21	BID SET	RAH
REVISIONS			

SEWAGE DISPOSAL BOARD
 OF THE CITY OF
RED BAY, ALABAMA
 PROPOSED CITY OF RED BAY
 SANITARY SEWER TRUNK LINE
 UPGRADE PROJECT
PHASE I - CONTRACT 4
 CWSRF NO. CS010833-03
**EXISTING FLOW
 SPLITTER BOX
 MODIFICATIONS**

Utility Engineering Consultants, LLC <small>130 Southcrest Drive Suite 100 Homewood, Alabama 35209</small>		DESIGNED	DRAWN	SCALE	DATE
		RAH	CBR	AS NOTED	DEC., 2020
		APPROVED	REFERENCE	JOB NO.	
			C002ADD3.DGN	RB20_051	
SHEET		6	OF		8